



### TEST REPORT

DATE: 03-31-2023

Page 1 of 1

TEST NUMBER: 0295655

<b>CLIENT</b>	Lions Floor
---------------	-------------

<b>TEST METHOD CONDUCTED</b>	ASTM F410 Standard Test Method for Wear Layer Thickness of Resilient Floor Coverings by Optical Measurement
------------------------------	---



DESCRIPTION OF TEST SAMPLE	
<b>IDENTIFICATION</b>	Comfort Heights
<b>COLOR</b>	Country Aura
<b>ROLL NUMBER</b>	SKU: LI-CH07
<b>CONSTRUCTION</b>	Laminate Flooring


#### GENERAL PRINCIPLE

The thickness of the wear layer of resilient non-textile floor coverings is determined by microscopic optical measurement. The specimen is examined in five areas and measurements are made on the outer most layer of the composite material. The measurements are recorded to the .0001 inch and averaged.

#### TEST RESULTS

		THICKNESS	
	SPECIMEN 1	0.0052 inch	
	SPECIMEN 2	0.0050 inch	
	SPECIMEN 3	0.0054 inch	
	SPECIMEN 4	0.0049 inch	
	SPECIMEN 5	0.0050 inch	

<b>AVERAGE TOTAL THICKNESS</b>	0.0051 Inch	5.1 mil
--------------------------------	-------------	---------

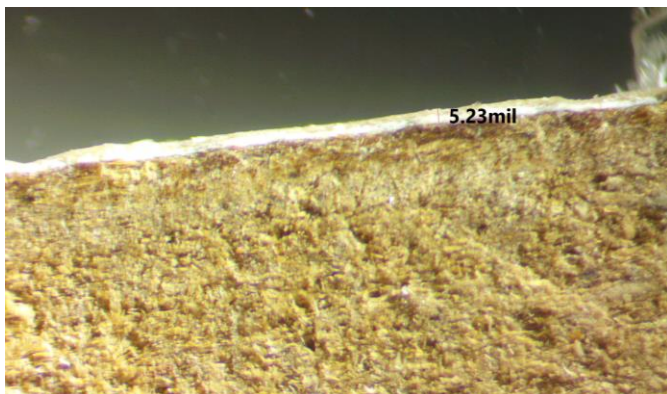

APPROVED BY:

This report is provided for the exclusive use of the client to whom it is addressed. It may be used in its entirety to gain product acceptance from duly constituted authorities. This report applies only to those samples tested and is not necessarily indicative of apparently identical of similar products. This report, or the name of Professional Testing Laboratory Inc. shall not be used under any circumstance in advertising to the general public.